

1～4号機サブドレンピットの 水質調査結果について


平成26年4月24日

東京電力株式会社



無断複製・転載禁止 東京電力株式会社

1～4号機サブドレンピット配置図

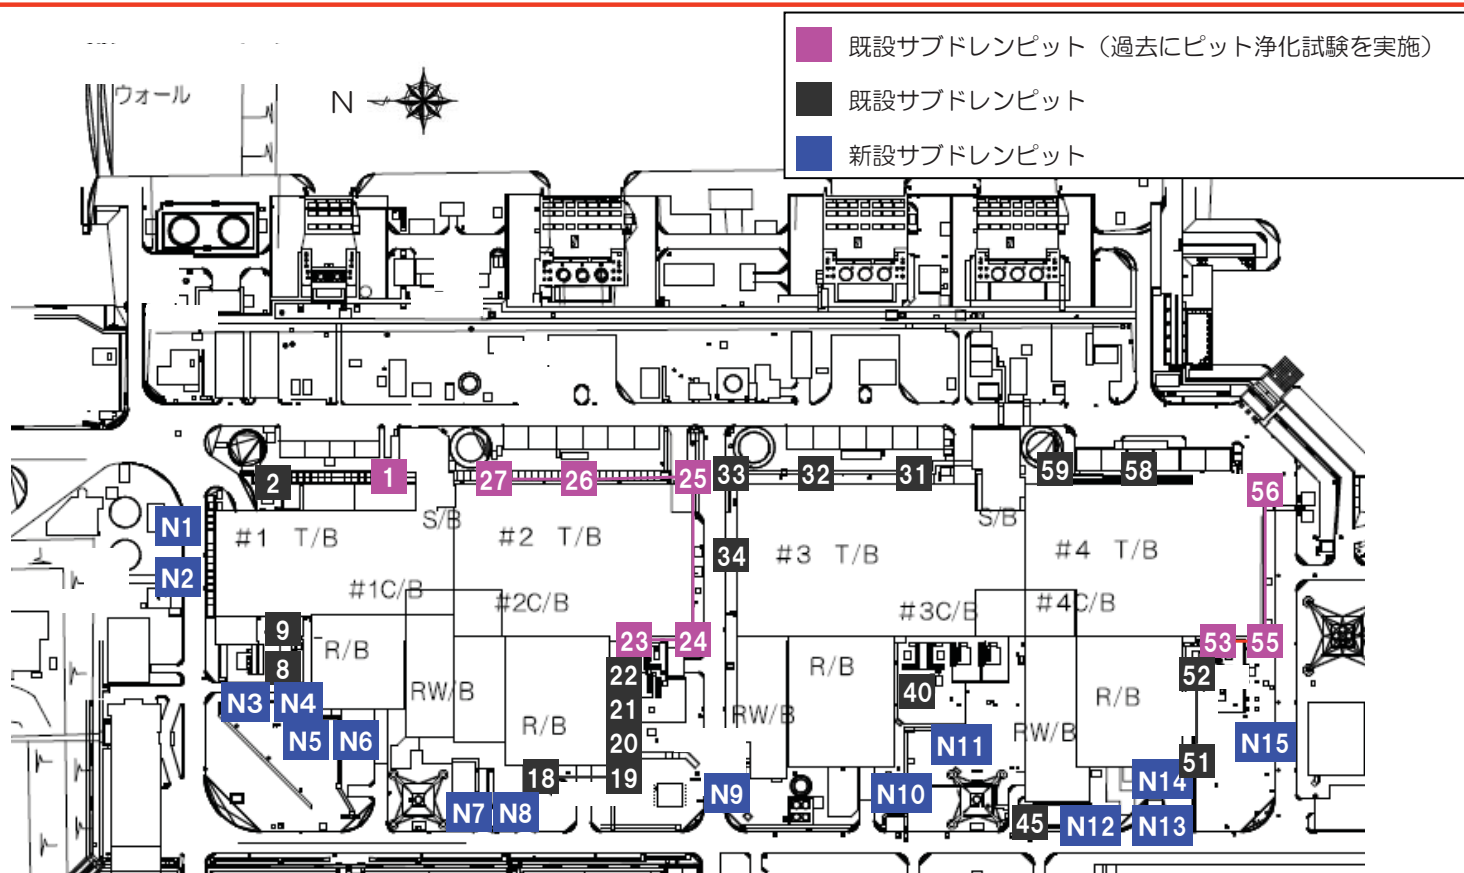

1～4号機サブドレンピットの水質調査結果

■ 今回採水した新設サブドレンピット内溜まり水の放射能濃度は、周辺の新設サブドレンピット内溜まり水と同程度である。

単位：Bq/L

	建屋	ビット	Cs-134					Cs-137					全β					H-3					Sb-125				
既設 ビット	1号機	1	68	180	300	96,000	ND(7.3)																				
		2	6.1	17	42	490	ND(2.8)																				
		8	800	2,100	3,100	450	ND(21)																				
		9	270	720	1,100	250	35																				
	2号機	18	140	340	690	3,200	ND(7.6)																				
		19	150	350	490	2,700	ND(9.3)																				
		20	27	64	140	2,500	34																				
		21	160	360	590	3,000	ND(10)																				
		22	110	270	550	1,300	ND(8.8)																				
		23	37	84	200	1,600	ND(4.0)																				
		24	45	100	200	750	ND(4.3)																				
		25	51	130	230	530	ND(6.3)																				
		26	72	190	340	190	ND(5.5)																				
		27	230	440	880	210	ND(10)																				
	3号機	31	10	24	55	650	12																				
		32	4.7	10	18	ND(2.8)	ND(2.3)																				
		33	25	68	68	55	ND(3.5)																				
		34	330	800	720	800	ND(14)																				
		40	-	-	-	-	-																				
新設 ビット(参考)	4号機	45	20	49	73	89	ND(3.0)																				
		51	-	-	-	-	-																				
		52	11	28	ND(15)	680	ND(4.4)																				
		53	1.1	4.6	ND(15)	530	ND(2.1)																				
		55	2.6	9.3	ND(15)	590	ND(2.6)																				
		56	1.1	4.5	ND(15)	770	ND(2.3)																				
		58	27	59	83	250	ND(4.5)																				
		59	42	99	94	430	ND(4.5)																				
	1号機	N1	ND(0.97)	ND(0.97)	ND(12)	36	ND(1.8)																				
		N2	ND(0.66)	ND(0.71)	ND(11)	110	ND(1.7)																				
		N3	3.0	7.2	ND(21)	320	ND(1.2)																				
		N4	4.8	12	62	320	32																				
		N5	5.2	5.7	ND(14)	490	ND(2.3)																				
		N6	ND(0.75)	ND(0.98)	ND(15)	160	ND(2.0)																				
		N7	1.1	2.2	ND(13)	18	ND(2.2)																				
	2号機	N8	1.3	2.7	ND(11)	55	ND(1.9)																				
		N9	4.0	11	23	1,100	ND(2.4)																				
	3号機	N10	-	-	-	-	-																				
		N11	-	-	-	-	-																				
		N12	-	-	-	-	-																				
	4号機	N13	-	-	-	-	-																				
		N14	-	-	-	-	-																				
		N15	-	-	-	-	-																				

※「-」部分は今後、採水が可能となった段階で水質調査予定
※「ND」は検出限界値未満を表し、()内に検出限界値を示す

「-」: 今回追加 (採水日: 平成26年3月26日)